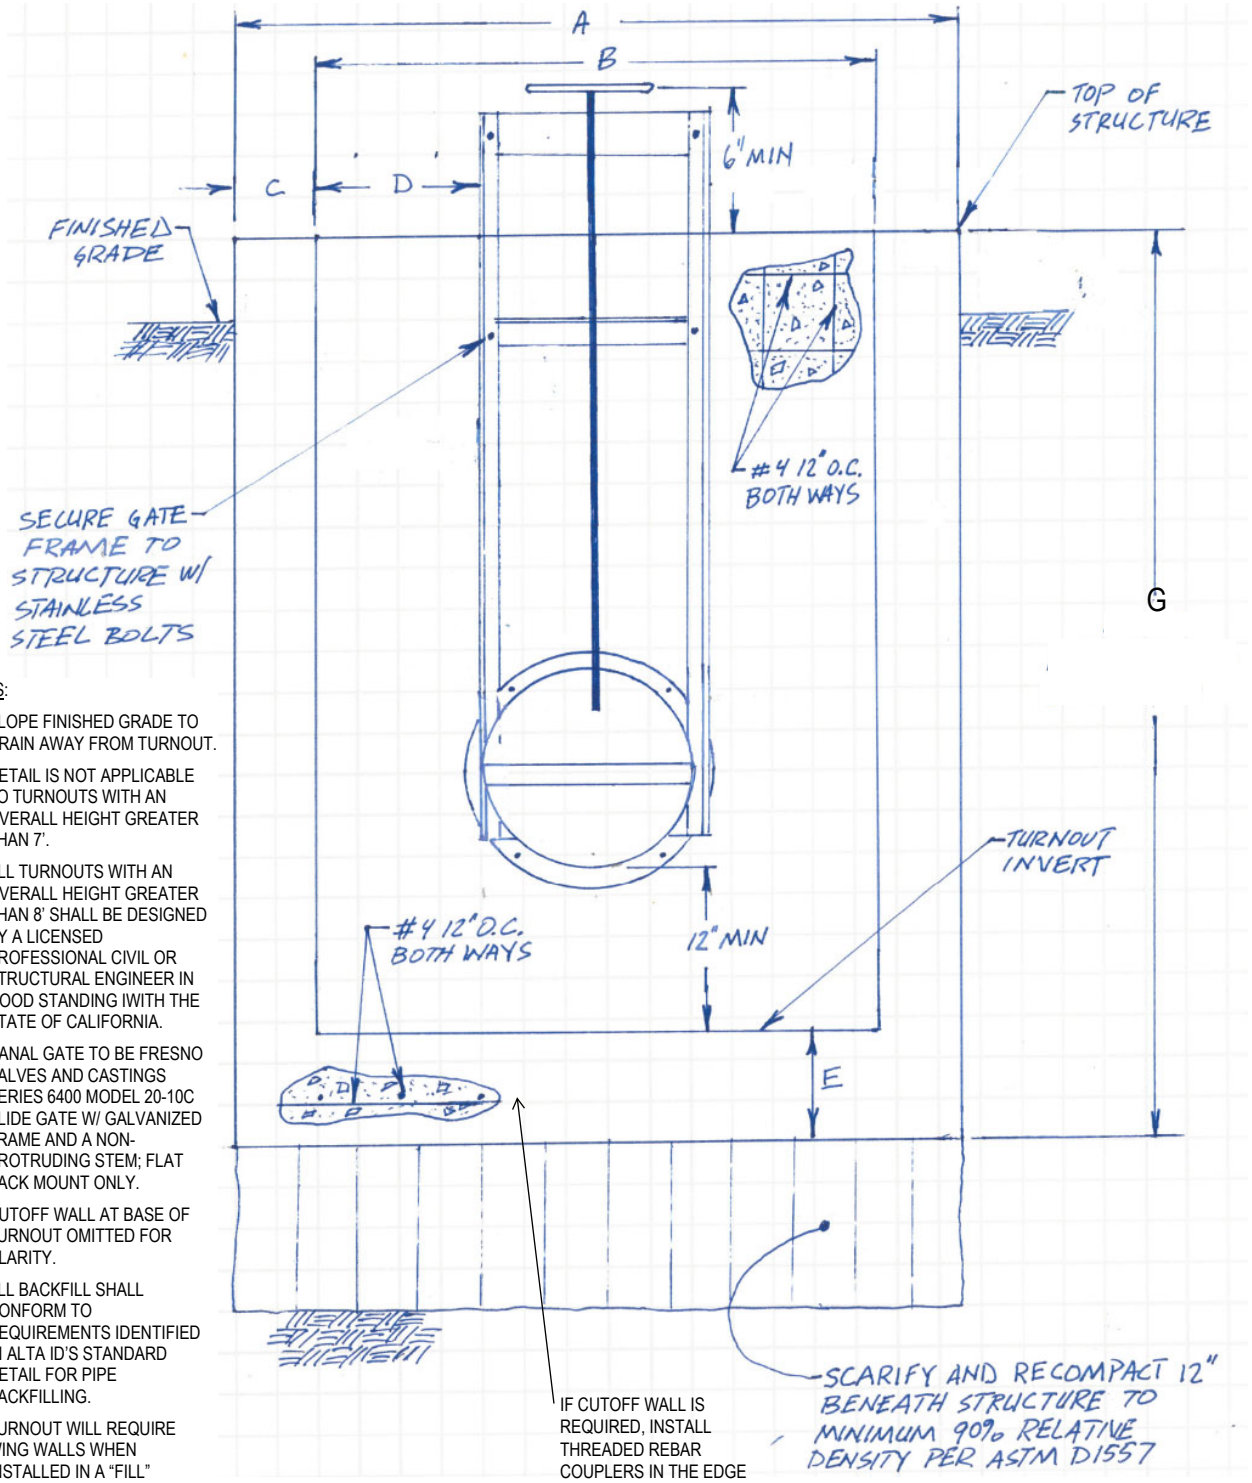

NOTES:

1. SLOPE FINISHED GRADE TO DRAIN AWAY FROM TURNOUT.
2. DETAIL IS NOT APPLICABLE TO TURNOUTS WITH AN OVERALL HEIGHT GREATER THAN 7'.
3. ALL TURNOUTS WITH AN OVERALL HEIGHT GREATER THAN 8' SHALL BE DESIGNED BY A LICENSED PROFESSIONAL CIVIL OR STRUCTURAL ENGINEER IN GOOD STANDING IWITH THE STATE OF CALIFORNIA.
4. CANAL GATE TO BE FRESNO VALVES AND CASTINGS SERIES 6400 MODEL 20-10C SLIDE GATE W/ GALVANIZED FRAME AND A NON-PROTRUDING STEM; FLAT BACK MOUNT ONLY.
5. CUTOFF WALL AT BASE OF TURNOUT OMITTED FOR CLARITY.
6. ALL BACKFILL SHALL CONFORM TO REQUIREMENTS IDENTIFIED IN ALTA ID'S STANDARD DETAIL FOR PIPE BACKFILLING.
7. TURNOUT WILL REQUIRE WING WALLS WHEN INSTALLED IN A "FILL" CONFIGURATION OF A CANAL EMBANKMENT.

Alta Irrigation District

TURNOUT – EARTHEN DITCH

SCALE:	DATE:	STANDARD DWG NO:
NOT TO SCALE	April 4, 2025	**TO-03**
		SHEET: 3 OF 6